

April 4, 2023

**RE: HUTCHINSON COUNTY COURTHOUSE DRAINAGE AND MENTOR
STREET IMPROVEMENTS
OLIVET, SOUTH DAKOTA
SPN #16138**

BID LETTING: TUESDAY, APRIL 11, 2023 @ 10:00 AM

ADDENDUM NUMBER 1

The following modifications are to be made to the specifications and plans for the Hutchinson County Courthouse Drainage and Mentor Street Improvements Project.

Section 33 42 00, Paragraph 2.02:

Delete Paragraph 2.02 in its entirety and replace with:


2.02 PERFORATED PVC DRAIN TILE PIPE

- A. Fittings and pipe for Polyvinyl Chloride (PVC) drain tile shall be of PVC with materials and dimensions conforming to the requirements of ASTM D3034 and F758 and shall have a smooth interior. The PVC pipe shall be SDR 26 or approved equal.
- B. All pipe shall be marked with the following: nominal pipe size, material code designation, SDR, pressure rating, manufacturer's name or trademark, NSF seal and ASTM numbers.
- C. The PVC pipe shall be furnished in maximum 20 foot laying lengths. Longer lengths will be allowed only if the Contractor certifies that he will provide equipment on the project to fully support the pipe while being transported and distributed over the project.
- D. All PVC pipe shall be furnished with gasketed joints conforming to ASTM D3212. Rubber gaskets shall conform to the requirements of ASTM F477.
- E. Manufacturer's proof of design tests and joint dimensions shall be submitted to the Engineer for gasket joints that do not maintain SDR throughout the joint.

- F. Gasket joint couplings used for plain end pipe shall have a pressure rating equal to the pipe in which it is used. Centering of the pipe within the coupling will be assured by means of an integral positive stop in the coupling. All couplings must be of the double gasket type. Couplings requiring welds will not be allowed.
- G. All gasketed joints shall have seating depth equal to at least 50% of the nominal pipe diameter.
- H. The ends of the pipe to be inserted into the couplings or joints shall be factory marked to allow field checking of the depth of setting of the pipe in the joint socket.
- I. The gasket lubricant shall be furnished and approved for the intended use by the pipe manufacturer.

All other items of the plans and specifications remain unchanged.

Jeffrey P. McCormick
 Jeffrey P. McCormick, Project Manager
 Schmucker, Paul, Nohr & Associates

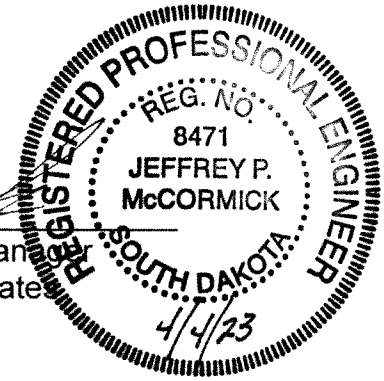

The undersigned hereby acknowledges receipt of Addendum Number 1 to the plans and specifications for the *HUTCHINSON COUNTY COURTHOUSE DRAINAGE AND MENTOR STREET IMPROVEMENTS*.

FIRM NAME _____
 BY _____
 TITLE _____
 DATE _____

ATTACH THIS SIGNED ADDENDUM NO. 1 TO THE BID FORM WHEN SUBMITTING.